


24V not connected to FCS circuitry.
Does not power FCS.

FCS-8-B-AI-L-DL






RELAY CONTROL WIRING:
CONNECT TO COM & NC.
DO NOT USE SOLID CORE WIRE.
RELAYS OPERATE IN A "FAIL SAFE" CONFIGURATION

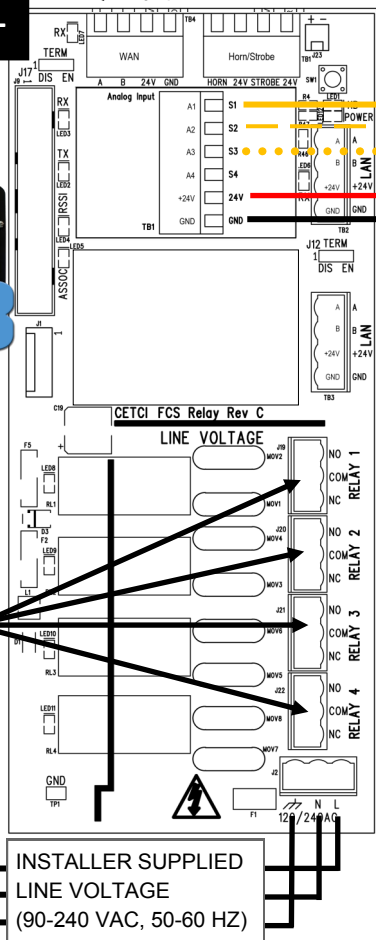

EARTH GROUND SHIELD (inside FCS enclosure)

INDIVIDUAL 4-20 mA SIGNAL WIRE FOR EACH ANALOG DEVICE

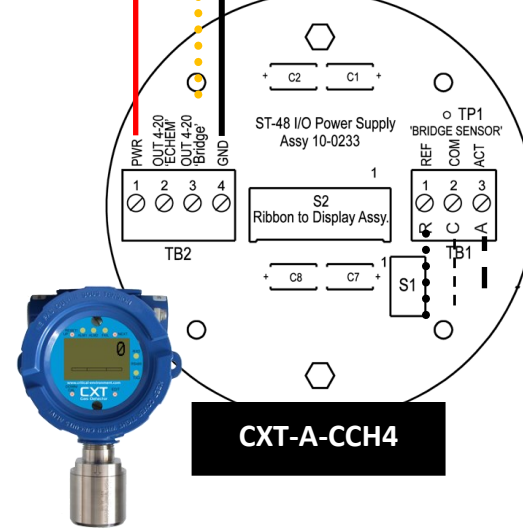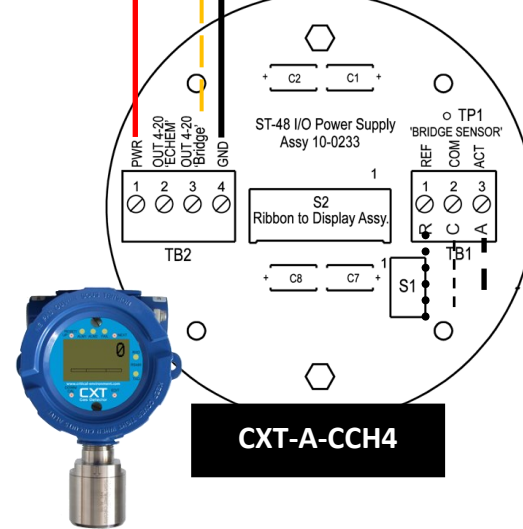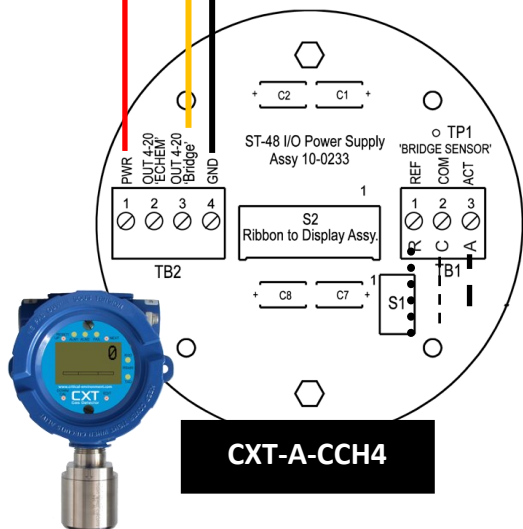

CRITICAL ENVIRONMENT TECHNOLOGIES CANADA INC.
www.critical-environment.com

**FCS-8-B-AI-L-DL CONTROLLER TO ANALOG
CXT-A-CCH4 METHANE TRANSMITTERS
WIRING CONNECTION DRAWING**

REV-A July 25, 2018