





INTERIOR OF QCC



THREE RELAY CONTROL WIRING TERMINALS. CONNECT TO COM & NC. DO NOT USE SOLID CORE WIRE.  
RELAYS OPERATE IN "FAIL SAFE" CONFIGURATON.

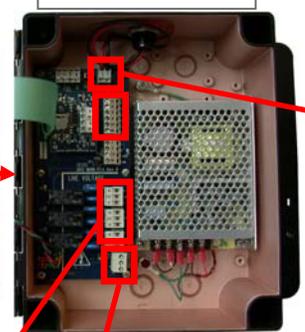


INSTALLER SUPPLIED LINE VOLTAGE (90-240 VAC, 50-60 HZ)



RAA-90



STROBE 4" DCMV

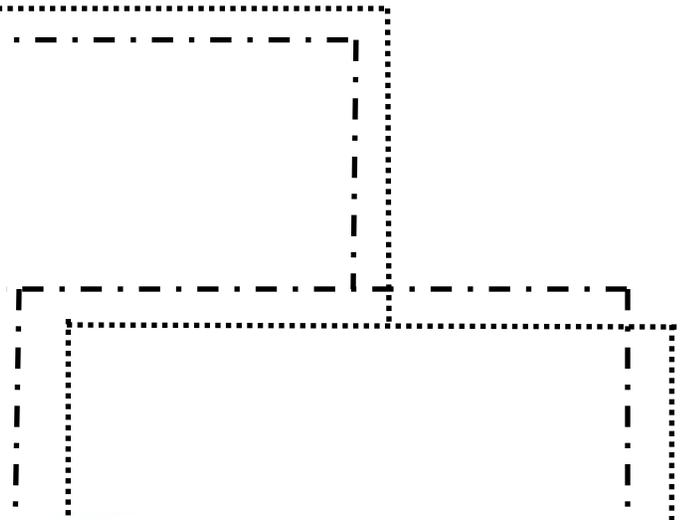

CRITICAL ENVIRONMENT TECHNOLOGIES CANADA INC. www.critical-environment.com  
QCC WITH PDC-OPTION-L and RAA-90 Connected to STROBE DRIVE  
WIRING CONNECTION DRAWING  
REV-B APRIL 12, 2017