


CRITICAL ENVIRONMENT TECHNOLOGIES CANADA INC.
 www.critical-environment.com

QCC-M TO TWO QCC-RDM WIRING CONNECTION DRAWING
 REV-A August 18, 2016



QCC-M

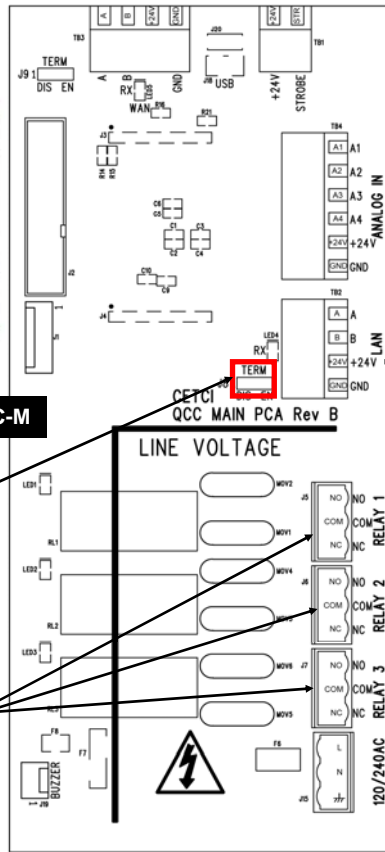

TERMINATION JUMPER IN EN POSITION IF FIRST DEVICE IN NETWORK CHAIN


THREE RELAY CONTROL WIRING TERMINALS. CONNECT TO COM & NC. DO NOT USE SOLID CORE WIRE.

RELAYS OPERATE IN "FAIL SAFE" CONFIGURATON.


EARTH GROUND SHIELD NOT CONNECTED (if last device)

EARTH GROUND SHIELD (inside QCC enclosure)


INSTALLER SUPPLIED LINE VOLTAGE (90-240 VAC, 50-60 HZ)



TERMINATION JUMPER IN EN POSITION IF LAST DEVICE IN NETWORK CHAIN

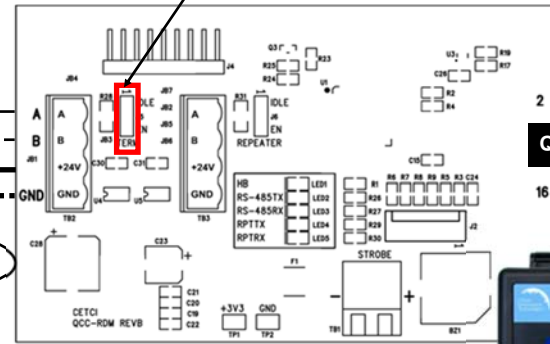

QCC-RDM

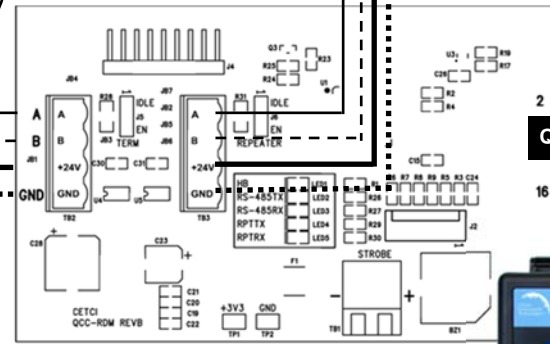

QCC-RDM

