





NOTE: OPTION -AO MUST BE INSTALLED.

THREE RELAY CONTROL WIRING TERMINALS.

CONNECT TO COM & NC.


DO NOT USE SOLID CORE WIRE.

RELAYS OPERATE IN "FAIL SAFE" CONFIGURATON.

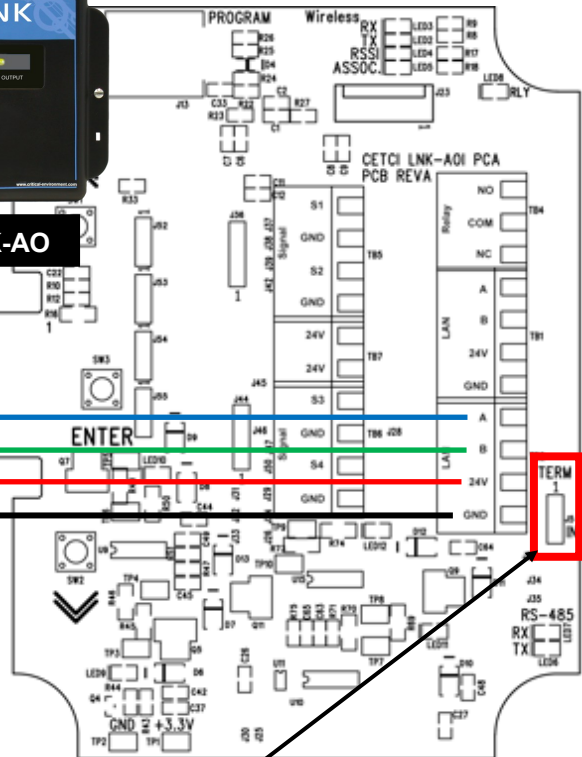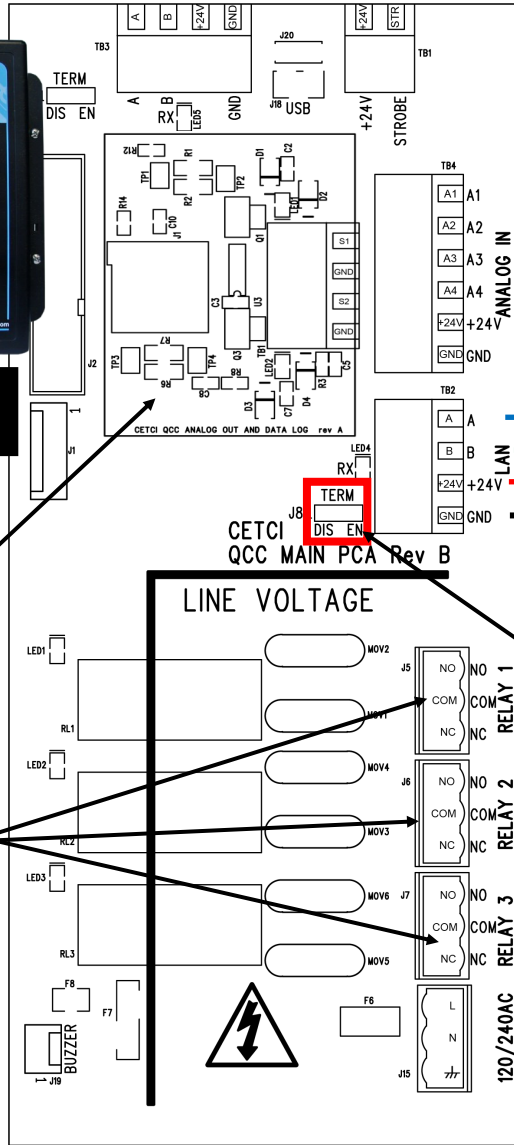

EARTH GROUND SHIELD (inside QCC enclosure)

TERMINATION JUMPER MUST BE INSTALLED ON FIRST AND LAST DEVICE IN NETWORK CHAIN.

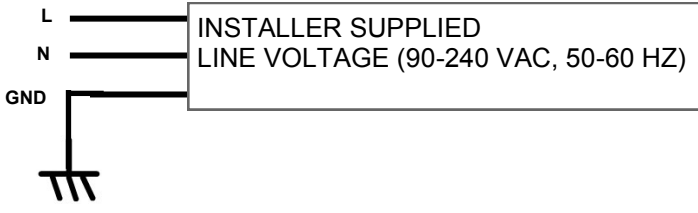

CRITICAL ENVIRONMENT TECHNOLOGIES CANADA INC.
www.critical-environment.com

QCC-M-AO TO LNK-AO WIRING CONNECTION DRAWING
REV-B February 4, 2019